

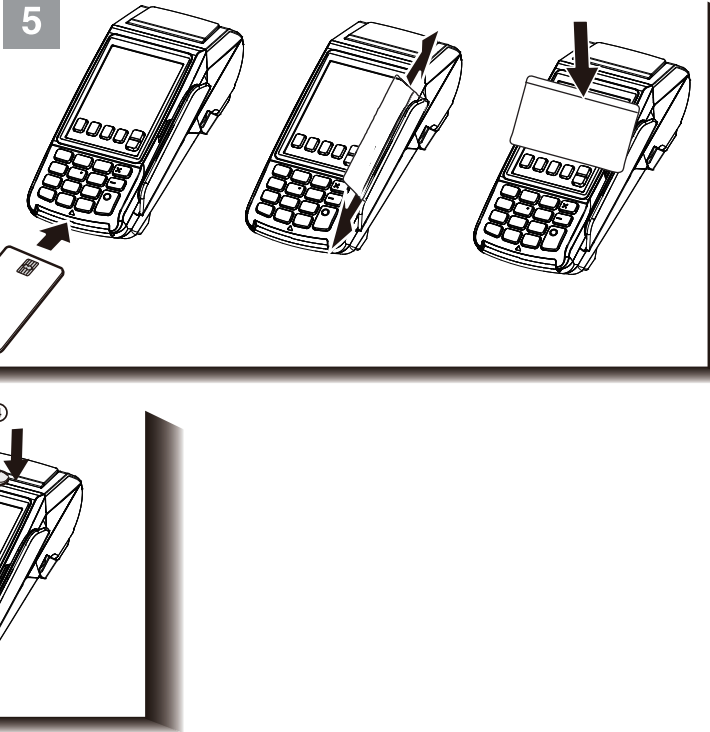
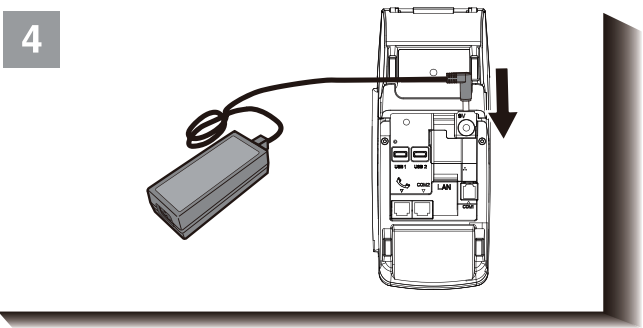
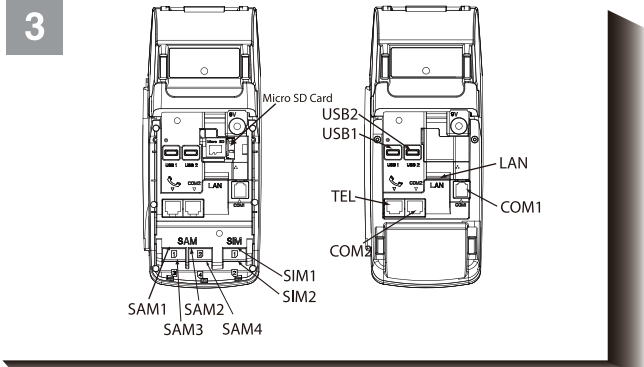


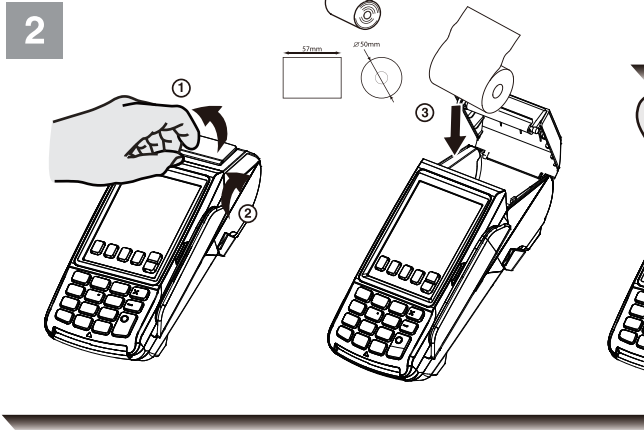

VEGA3000 Countertop Series

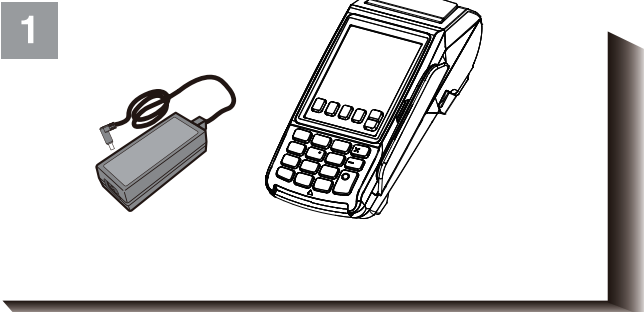

2.4" COUNTERTOP with CL / 3.5" COUNTERTOP with CL

Basic Spec			
Dimension	190mm(L)x78mm(W)x78mm(H)		
Environment	Temperature	Operation	0°C to 50°C
		Storage	-20°C to 70°C
	Humidity	Operation	5% to 90% non-condensing
		Storage	5% to 95% non-condensing
Power Supply	DC 9V/4A		

EMV Level 1 Approval
 VEGA3000 has obtained EMV Level 1 approval.
 To confirm that such approval by referring to the list of approved interface modules published on the EMVCo website (www.emvco.com) or CASTLES TECHNOLOGY website (www.castlestechnology.com).

USA & Canada declaration of conformity (for UL marked products)

We CASTLES TECHNOLOGY CO., LTD, 6F., No.207-5, Sec. 3, Beixin Rd., Xindian District, New Taipei City 23143, Taiwan (R.O.C.) -declare that this product VEGA3000, when installed, maintained and used in the application for which it was made, with the manufacturer's instructions, is in conformity with the following standards: UL 60950, CSA C22.2 no 60950, FCC 47 CFR part 15, 22 and 24, NAPRD.03 for PTRCB.

CE declaration of conformity
 We undersigned, CASTLES TECHNOLOGY CO., LTD, 6F., No.207-5, Sec. 3, Beixin Rd., Xindian District, New Taipei City 23143, Taiwan (R.O.C.) -certify under our sole responsibility that the following apparatus:

Type of Product: EFTPOS
 Manufacturer: CASTLES TECHNOLOGY CO., LTD
 Model Number: VEGA3000
 conforms to the essential requirement of Electromagnetic compatibility(EMC)
 Directive 2004/108/EC and 1995/5/EC, based on the following specifications applied: EU Harmonized Standards:
 EN 60950-1 :2006/A11 :2009/A1 :2010/A12 :2011, EN 50566:2013, EN 62479 :2010, EN 62209-2 (2010-03), EN 301 489-01 V1.9.2 (2011-09), EN 301 489-03 V1.4.1 (2002-08), EN 301 489-07 V1.3.1 (2005-11), EN 301 489-17 V2.2.1 (2012-09), EN 301 489-24 V1.5.1 (2010-10), EN 55022:2010/AG: 2011, EN 55024:2010, EN 61000-3-2:2006+A1:2009+A2:2009, EN 61000-3-3:2013, EN 301 511 V9.0.2 (2003-03), EN 301 908-1 V6.2.1 (2013-04), EN 301 908-2 V5.4.1 (2012-12), EN 300 328 V1.8.1 (2012-04), EN 302 291-1 V1.1.1 (2005-07), EN 302 291-2 V1.1.1 (2005-07)

The following Notified Body has issued a positive Statement of Opinion:
 Name: TUV SUD BABT
 Address: Forsyth House, Churchfield Road, Walton-on-Thames, Surrey, KT12 2TD, UK

The related technical documentation is kept at the following address:
 CASTLES TECHNOLOGY CO., LTD
 6F., No.207-5, Sec. 3, Beixin Rd., Xindian District, New Taipei City 23143, Taiwan (R.O.C.)

Safety recommendations prior to end of life
 Only use the power supply provided with the terminal.
 Connecting the terminal to any other external voltage source is strongly not recommended.
 To prevent risk of electric shock:
 Do not open the front or back of the terminal.
 Do not expose the terminal to rain or moisture.
 Call a qualified technician for servicing (the terminal does not contain any user serviceable part).
 If the terminal is dropped accidentally, disconnect the terminal and call the maintenance center for assistance.
 This terminal is power on automatically while plug in the power connector. If you want to turn off the terminal just unplug the power connector to turn off the power.

Information notification for correct disposal of the product in accordance with EC Directive 2004/108/EC
 At the end of its working life, this product must not be disposed of as urban waste.
 It must be taken to a special local authority differentiated waste collection center or the dealer providing this service.
 This product is marked with a statutory crossed-out wheeled dustbin as a reminder of the need to dispose electrical appliance separately.
 Disposing of electrical appliance separately avoids possible negative consequences for the environment and health deriving from inappropriate disposal and enables the constituent materials to be recovered to obtain significant savings in energy and resources.